


Quality of Water in the Vaal Barrage Reservoir

Date Sampled 3 October 2018

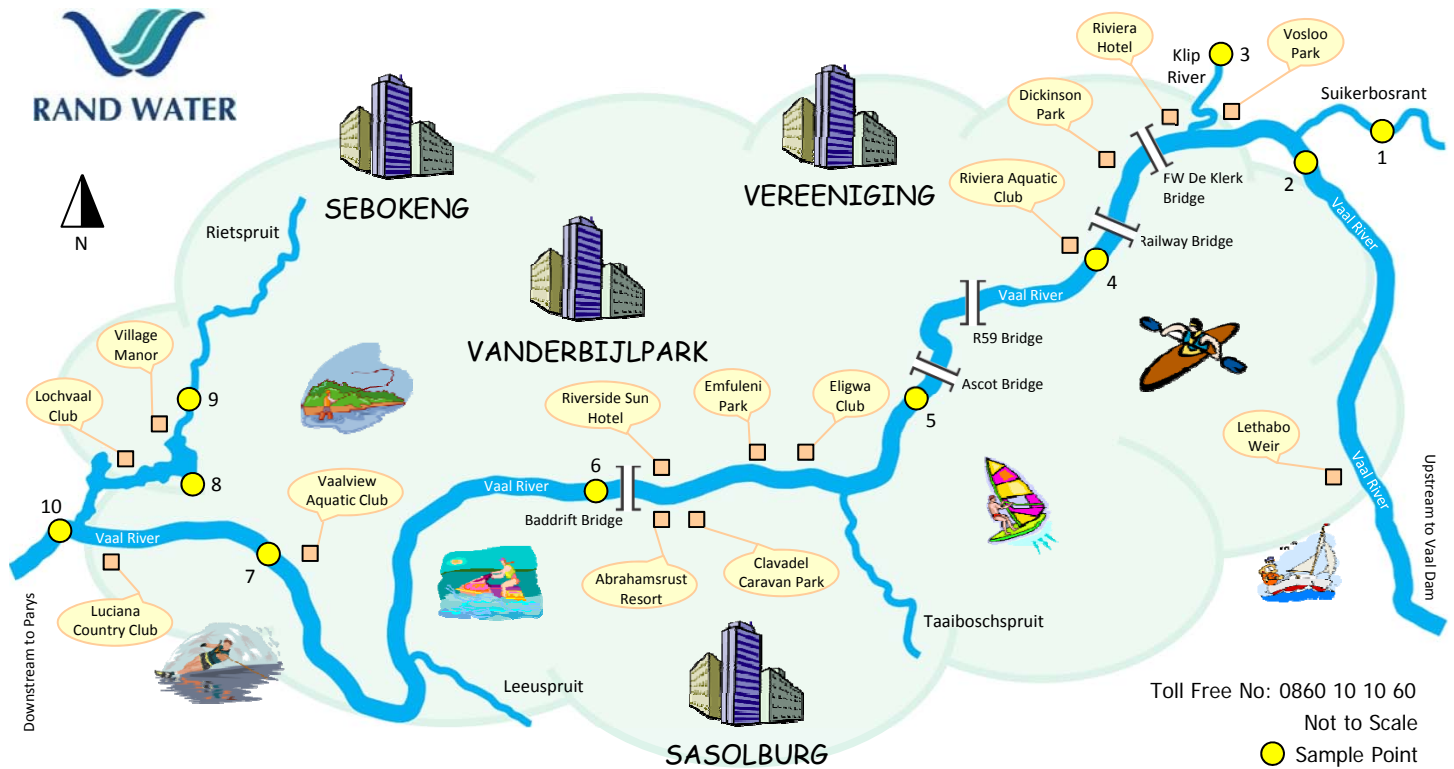

Interpretation of the results obtained from water samples collected at the respective sample points (refer map above).

Escherichia coli (E.coli) Predicted symptoms include: Skin irritations, infections & intestinal disorders*	E.coli counts per 100ml at sample points									
	1	2	3	4	5	6	7	8	9	10
	This Week	172	4	2,420	1,986	365	44	8	108	46,110
Last Week	133	19	2,920	14,970	921	24	13	410	57,940	158
Guideline	Low risk of gastrointestinal disorders <i>E.coli</i> < 130 counts/100ml			Slight risk of gastrointestinal disorders <i>E.coli</i> 130 - 200 counts/100ml		Significant risk of gastrointestinal disorders <i>E.coli</i> 200 - 400 counts/100ml			High risk of gastrointestinal disorders <i>E.coli</i> > 400 counts/100ml	

Blue Green Algae Predicted symptoms include: Skin irritations, infections & intestinal disorders*	Blue Green algae counts at sample points									
	1	2	3	4	5	6	7	8	9	10
	This Week	< 40	2,413	603	3,982	241	< 40	121	2,051	< 40
Last Week	575	1,689	579	241	2,413	1,569	115	1,629	1,086	724
Guideline	Low Risk Blue Green algae < 20,000 cells/ml			Moderate Risk Blue Green algae 20,000 - 100,000 cells/ml			High Risk Blue Green algae > 100,000 cells/ml			

Algal Pigments Predicted nuisance conditions include: Scums & smells	Algal pigments expressed as Chlorophyll-a levels at sample points									
	1	2	3	4	5	6	7	8	9	10
	This Week	16	11	34	98	392	170	4	303	15
Last Week	13	22	5	21	132	82	34	296	9	126
Guideline	Low Risk Chlorophyll-a < 15ug/l			Moderate Risk Chlorophyll-a 15 - 30ug/l			High Risk Chlorophyll-a > 30ug/l			

* If ingested. X Sample not received / no data available. Reports generated every Friday of the year.

DISCLAIMER: Although Rand Water has made every endeavour to make an accurate assessment of the parameters described above (based on published South African and international criteria), neither Rand Water, nor any of its officials, shall be responsible for any damage or health related problems that may result due to the use of the Vaal Barrage Reservoir for any purpose.