


# Quality of Water in the Vaal Barrage Reservoir

Date Sampled 10 January 2018

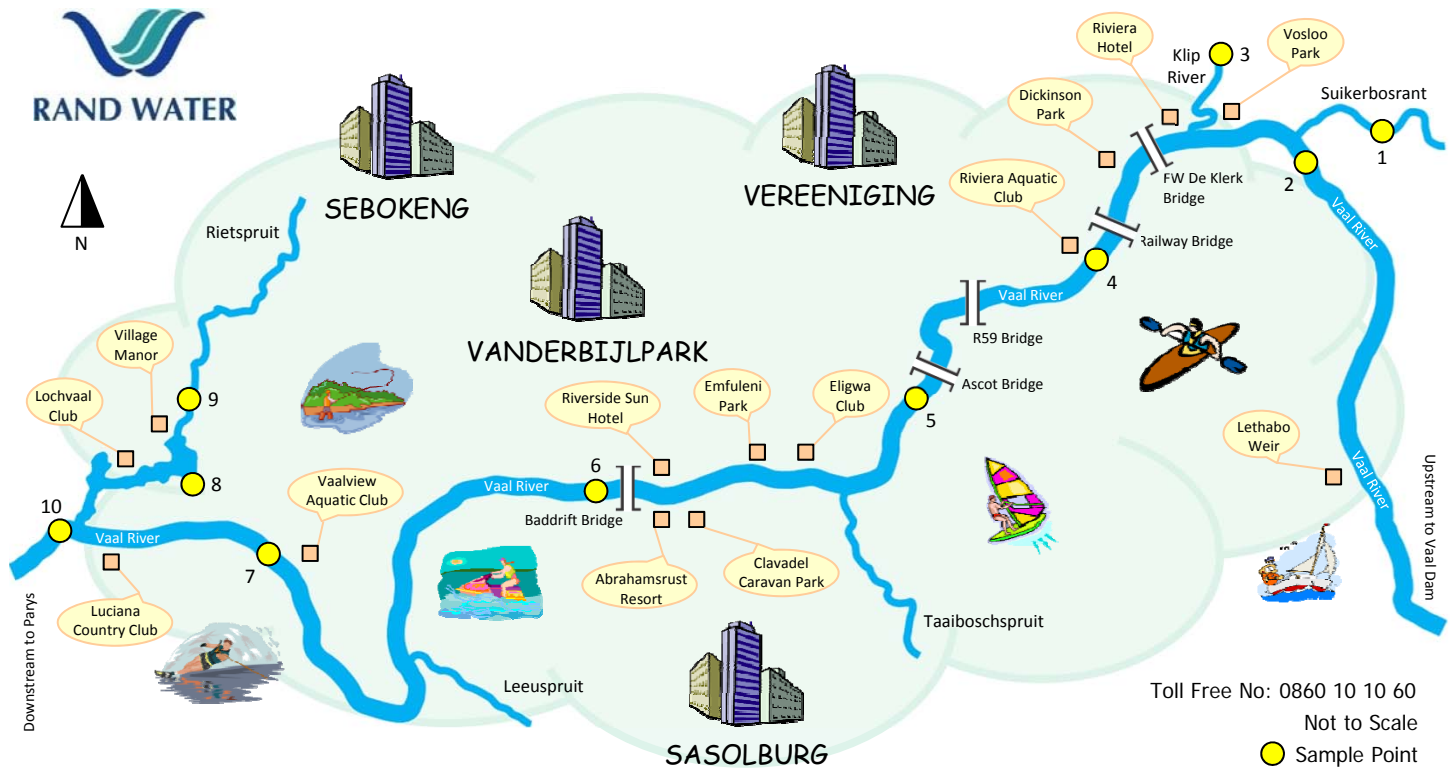

Interpretation of the results obtained from water samples collected at the respective sample points (refer map above).

<b>Escherichia coli (E.coli)</b> Predicted symptoms include: Skin irritations, infections & intestinal disorders*	<b>E.coli counts per 100ml at sample points</b>									
	1	2	3	4	5	6	7	8	9	10
	This Week	579	28	1,414	> 2,420	866	6	2	12	11,870
Last Week	236	5	411	310	387	173	16	37	7,890	15
<b>Guideline</b>	Low risk of gastrointestinal disorders <i>E.coli</i> < 130 counts/100ml			Slight risk of gastrointestinal disorders <i>E.coli</i> 130 - 200 counts/100ml		Significant risk of gastrointestinal disorders <i>E.coli</i> 200 - 400 counts/100ml		High risk of gastrointestinal disorders <i>E.coli</i> > 400 counts/100ml		

<b>Blue Green Algae</b> Predicted symptoms include: Skin irritations, infections & intestinal disorders*	<b>Blue Green algae counts at sample points</b>									
	1	2	3	4	5	6	7	8	9	10
	This Week	362	21,599	367	5,189	7,361	670	9,412	18,703	1,086
Last Week	< 40	17,135	362	3,137	483	2,069	724	965	< 40	11,116
<b>Guideline</b>	Low Risk Blue Green algae < 20,000 cells/ml			Moderate Risk Blue Green algae 20,000 - 100,000 cells/ml			High Risk Blue Green algae > 100,000 cells/ml			

<b>Algal Pigments</b> Predicted nuisance conditions include: Scums & smells	<b>Algal pigments expressed as Chlorophyll-a levels at sample points</b>									
	1	2	3	4	5	6	7	8	9	10
	This Week	14	18	5	21	26	29	39	101	28
Last Week	10	17	6	26	22	13	30	75	20	52
<b>Guideline</b>	Low Risk Chlorophyll-a < 15ug/l			Moderate Risk Chlorophyll-a 15 - 30ug/l			High Risk Chlorophyll-a > 30ug/l			

\* If ingested. X Sample not received / no data available. Reports generated every Friday of the year.

DISCLAIMER: Although Rand Water has made every endeavour to make an accurate assessment of the parameters described above (based on published South African and international criteria), neither Rand Water, nor any of its officials, shall be responsible for any damage or health related problems that may result due to the use of the Vaal Barrage Reservoir for any purpose.