


# Quality of Water in the Vaal Barrage Reservoir

Date Sampled 6 September 2017

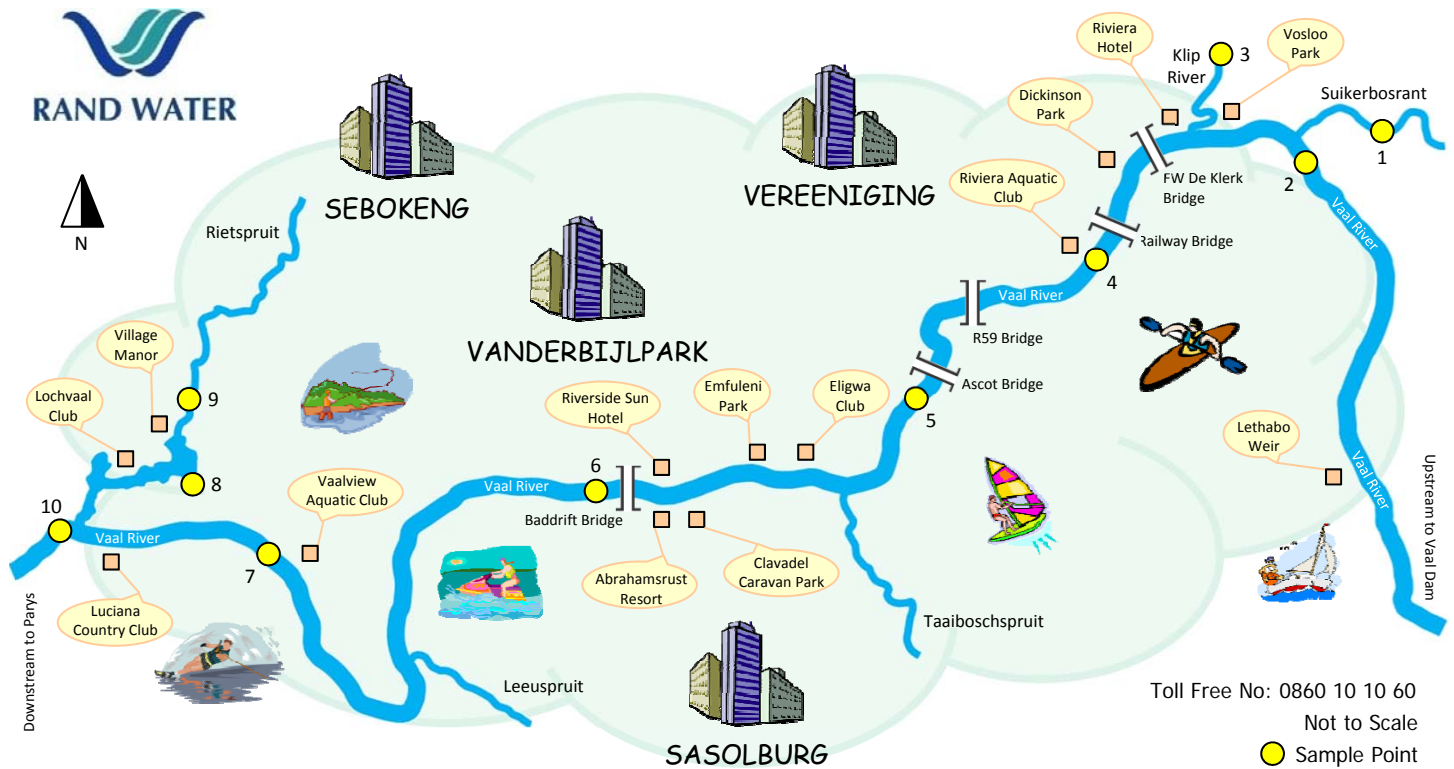

Interpretation of the results obtained from water samples collected at the respective sample points (refer map above).

<b><i>Escherichia coli</i> (<i>E.coli</i>)</b> Predicted symptoms include: Skin irritations, infections & intestinal disorders*	<i>E.coli</i> counts per 100ml at sample points									
	1	2	3	4	5	6	7	8	9	10
	This Week	127	36	3,130	19,180	2,920	23	49	435	435,200
Last Week	93	22	1,203	12,740	10,670	38	0	7,490	344,800	104
Guideline	Low risk of gastrointestinal disorders <i>E.coli</i> < 130 counts/100ml			Slight risk of gastrointestinal disorders <i>E.coli</i> 130 - 200 counts/100ml		Significant risk of gastrointestinal disorders <i>E.coli</i> 200 - 400 counts/100ml			High risk of gastrointestinal disorders <i>E.coli</i> > 400 counts/100ml	

<b>Blue Green Algae</b> Predicted symptoms include: Skin irritations, infections & intestinal disorders*	Blue Green algae counts at sample points									
	1	2	3	4	5	6	7	8	9	10
	This Week	< 40	201	< 40	< 40	< 40	121	< 40	210	603
Last Week	< 40	121	< 40	< 40	121	< 40	< 40	724	1,086	< 40
Guideline	Low Risk Blue Green algae < 20,000 cells/ml			Moderate Risk Blue Green algae 20,000 - 100,000 cells/ml			High Risk Blue Green algae > 100,000 cells/ml			

<b>Algal Pigments</b> Predicted nuisance conditions include: Scums & smells	Algal pigments expressed as Chlorophyll-a levels at sample points									
	1	2	3	4	5	6	7	8	9	10
	This Week	0	42	< 2	24	< 2	180	181	40	16
Last Week	7	7	8	20	64	25	244	46	27	34
Guideline	Low Risk Chlorophyll-a < 15ug/l			Moderate Risk Chlorophyll-a 15 - 30ug/l			High Risk Chlorophyll-a > 30ug/l			

\* If ingested. X Sample not received / no data available. Reports generated every Friday of the year.

DISCLAIMER: Although Rand Water has made every endeavour to make an accurate assessment of the parameters described above (based on published South African and international criteria), neither Rand Water, nor any of its officials, shall be responsible for any damage or health related problems that may result due to the use of the Vaal Barrage Reservoir for any purpose.